

1 2 3 4 5 6

A

B

C

A


B

C

D

Fabrication Specifications				
ITEM	INDEX	DEPTH (mm)	DIA. (mm)	CLOCKFACE POSITION
Tank depth	A			-
Tank Ø	B			-
Inlet	C1		110	
Inlet	C2			
Inlet	C3			
Discharge	D		63	
Cable duct			110	
Vent			110	


Kiosk (Single Door)		
Length (mm)	Width (mm)	Height (mm)
750	400	1250

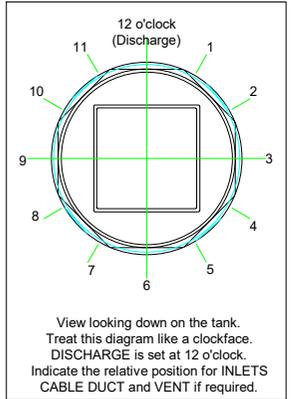

**Comments**

Please Note - Inlet invert should be between 400 - 1050 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

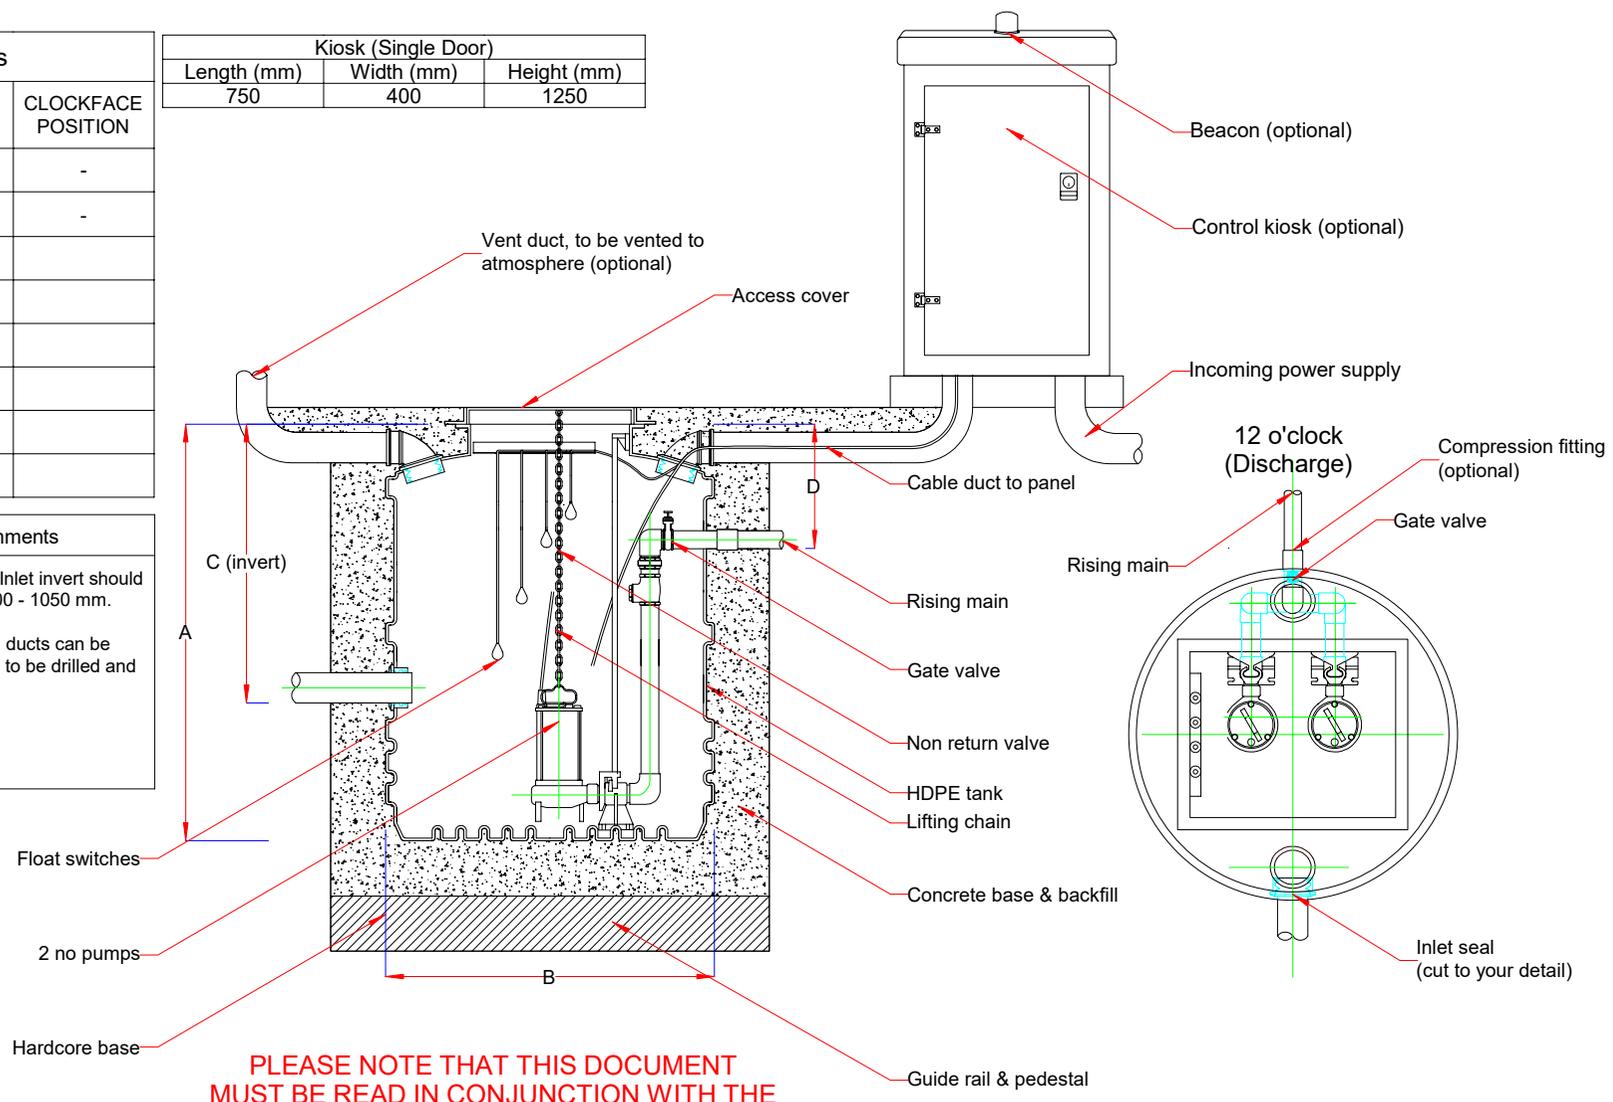

**PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES**

1 2 3 4 5 6

REV	DETAIL	DATE	DRAWN	TITLE

CUSTOMER			
----------	--	--	--

DRAWN	
gf	
SCALE	
NOT TO SCALE	
SHEET	
1 of 1	
TOLERANCE +/- 2%	REV 0

